



PROFIL KANALIZACJI DESZCZOWEJ cz.2 ---- 100/500

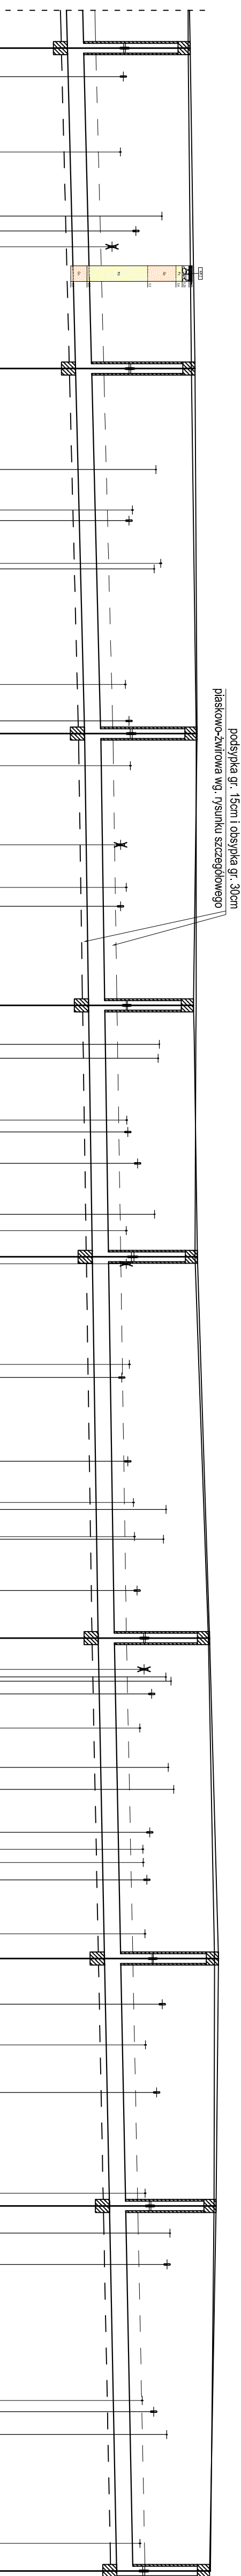

Rzędna projektowanego terenu	107,30	107,42		107,47		107,38		107,40		107,48		107,78		108,00		107,94		107,78	
Rzędna istniejącego terenu	107,25	107,33		107,45		107,45		107,44		107,42		107,75		107,90		107,89		107,80	
Rzędna dna proj. kanalu	104,27	104,47		104,69		104,70		104,79		104,88		105,03		105,18		105,31		105,49	
Zagłęb. dna względem terenu proj.	3,03	2,95		2,78		2,76		2,59		2,60		2,60		2,75		2,63		2,29	
Długość odcinka		39,5		45,0		4,0		29,5		31,0		47,0		39,5		30,5		45,0	
Proj. spadek kanalu, odległość	L=84,5					L=111,5								L=115,0					
Proj. średnica nominalna, materiał				I=5,0 ‰						DN 400mm PVC SN 8				I=3,0 ‰				I=4,0 ‰	

Nazwa węzła		Hektometr i odległości	
D8		94,5	3
		98,0	
		7,5	
		15,5	
		19,0	
D9		34,0	
		46,5	
		51,5	
		58,0	
		73,0	
D10		79,0	
		83,0	
		93,0	
		98,0	
		4	
D11		12,5	
		17,5	
		27,0	
		32,0	
		38,5	
D12		43,5	
		57,0	
		69,0	
		74,0	
		78,0	
D13		85,0	
		90,5	
		94,5	
		97,5	
		5	
D14		6,5	
		9,5	
		14,5	
		18,5	
		27,0	
D15		30,0	
		36,0	
		41,0	
		46,5	
		60,5	
D1		64,0	
		68,0	
		84,5	
		89,0	
		2,5	
		5,5	9

[illegible]